



THE MANUFACTURER RESERVES THE RIGHT TO SUBSTITUTE/CHANGE COMPONENTS OF THE SYSTEM AS DEEMED NECESSARY WITHOUT PRIOR NOTICE TO THE CUSTOMER. THESE COMPONENTS WILL BE COVERED BY THE MANUFACTURER’S WARRANTY.

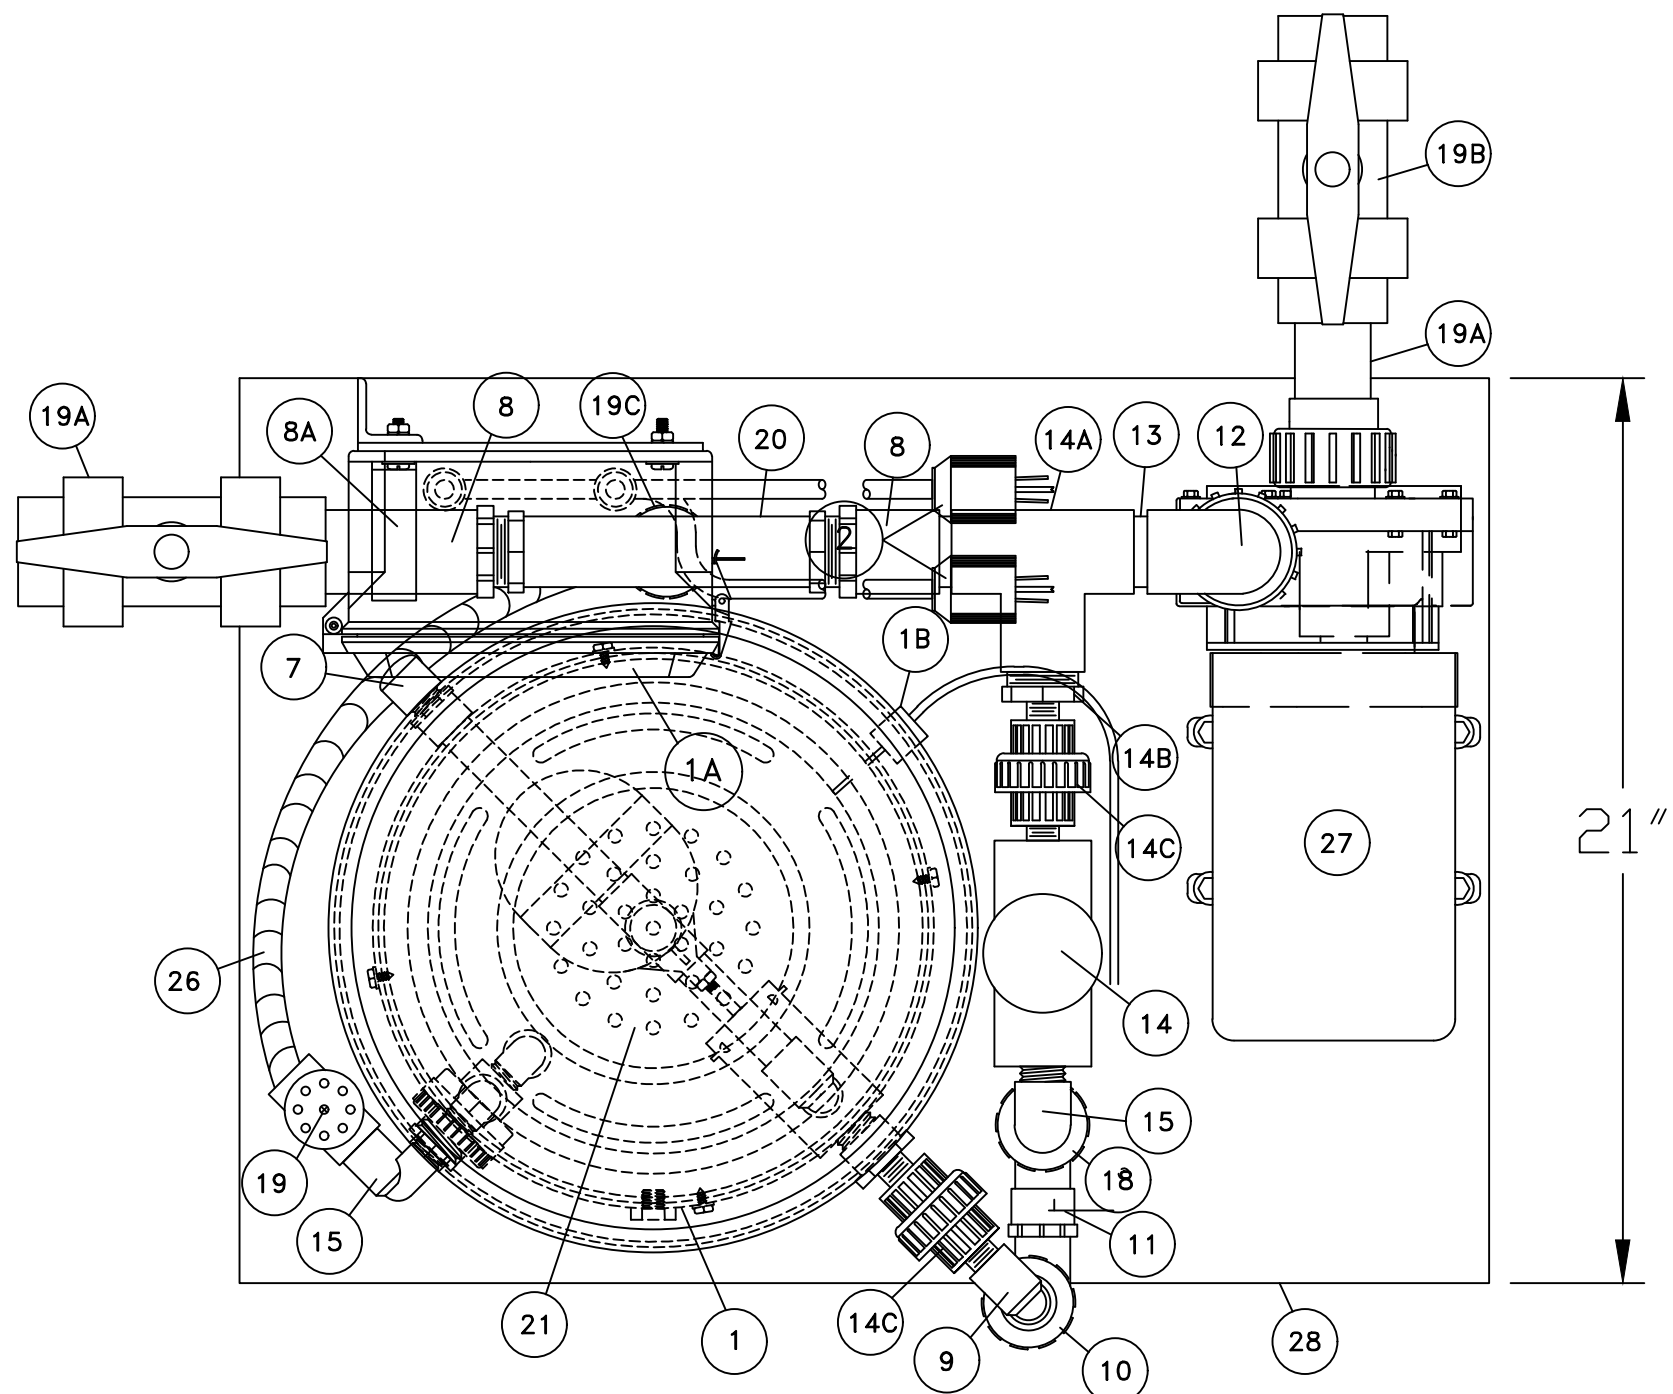

SYSTEM PLAN

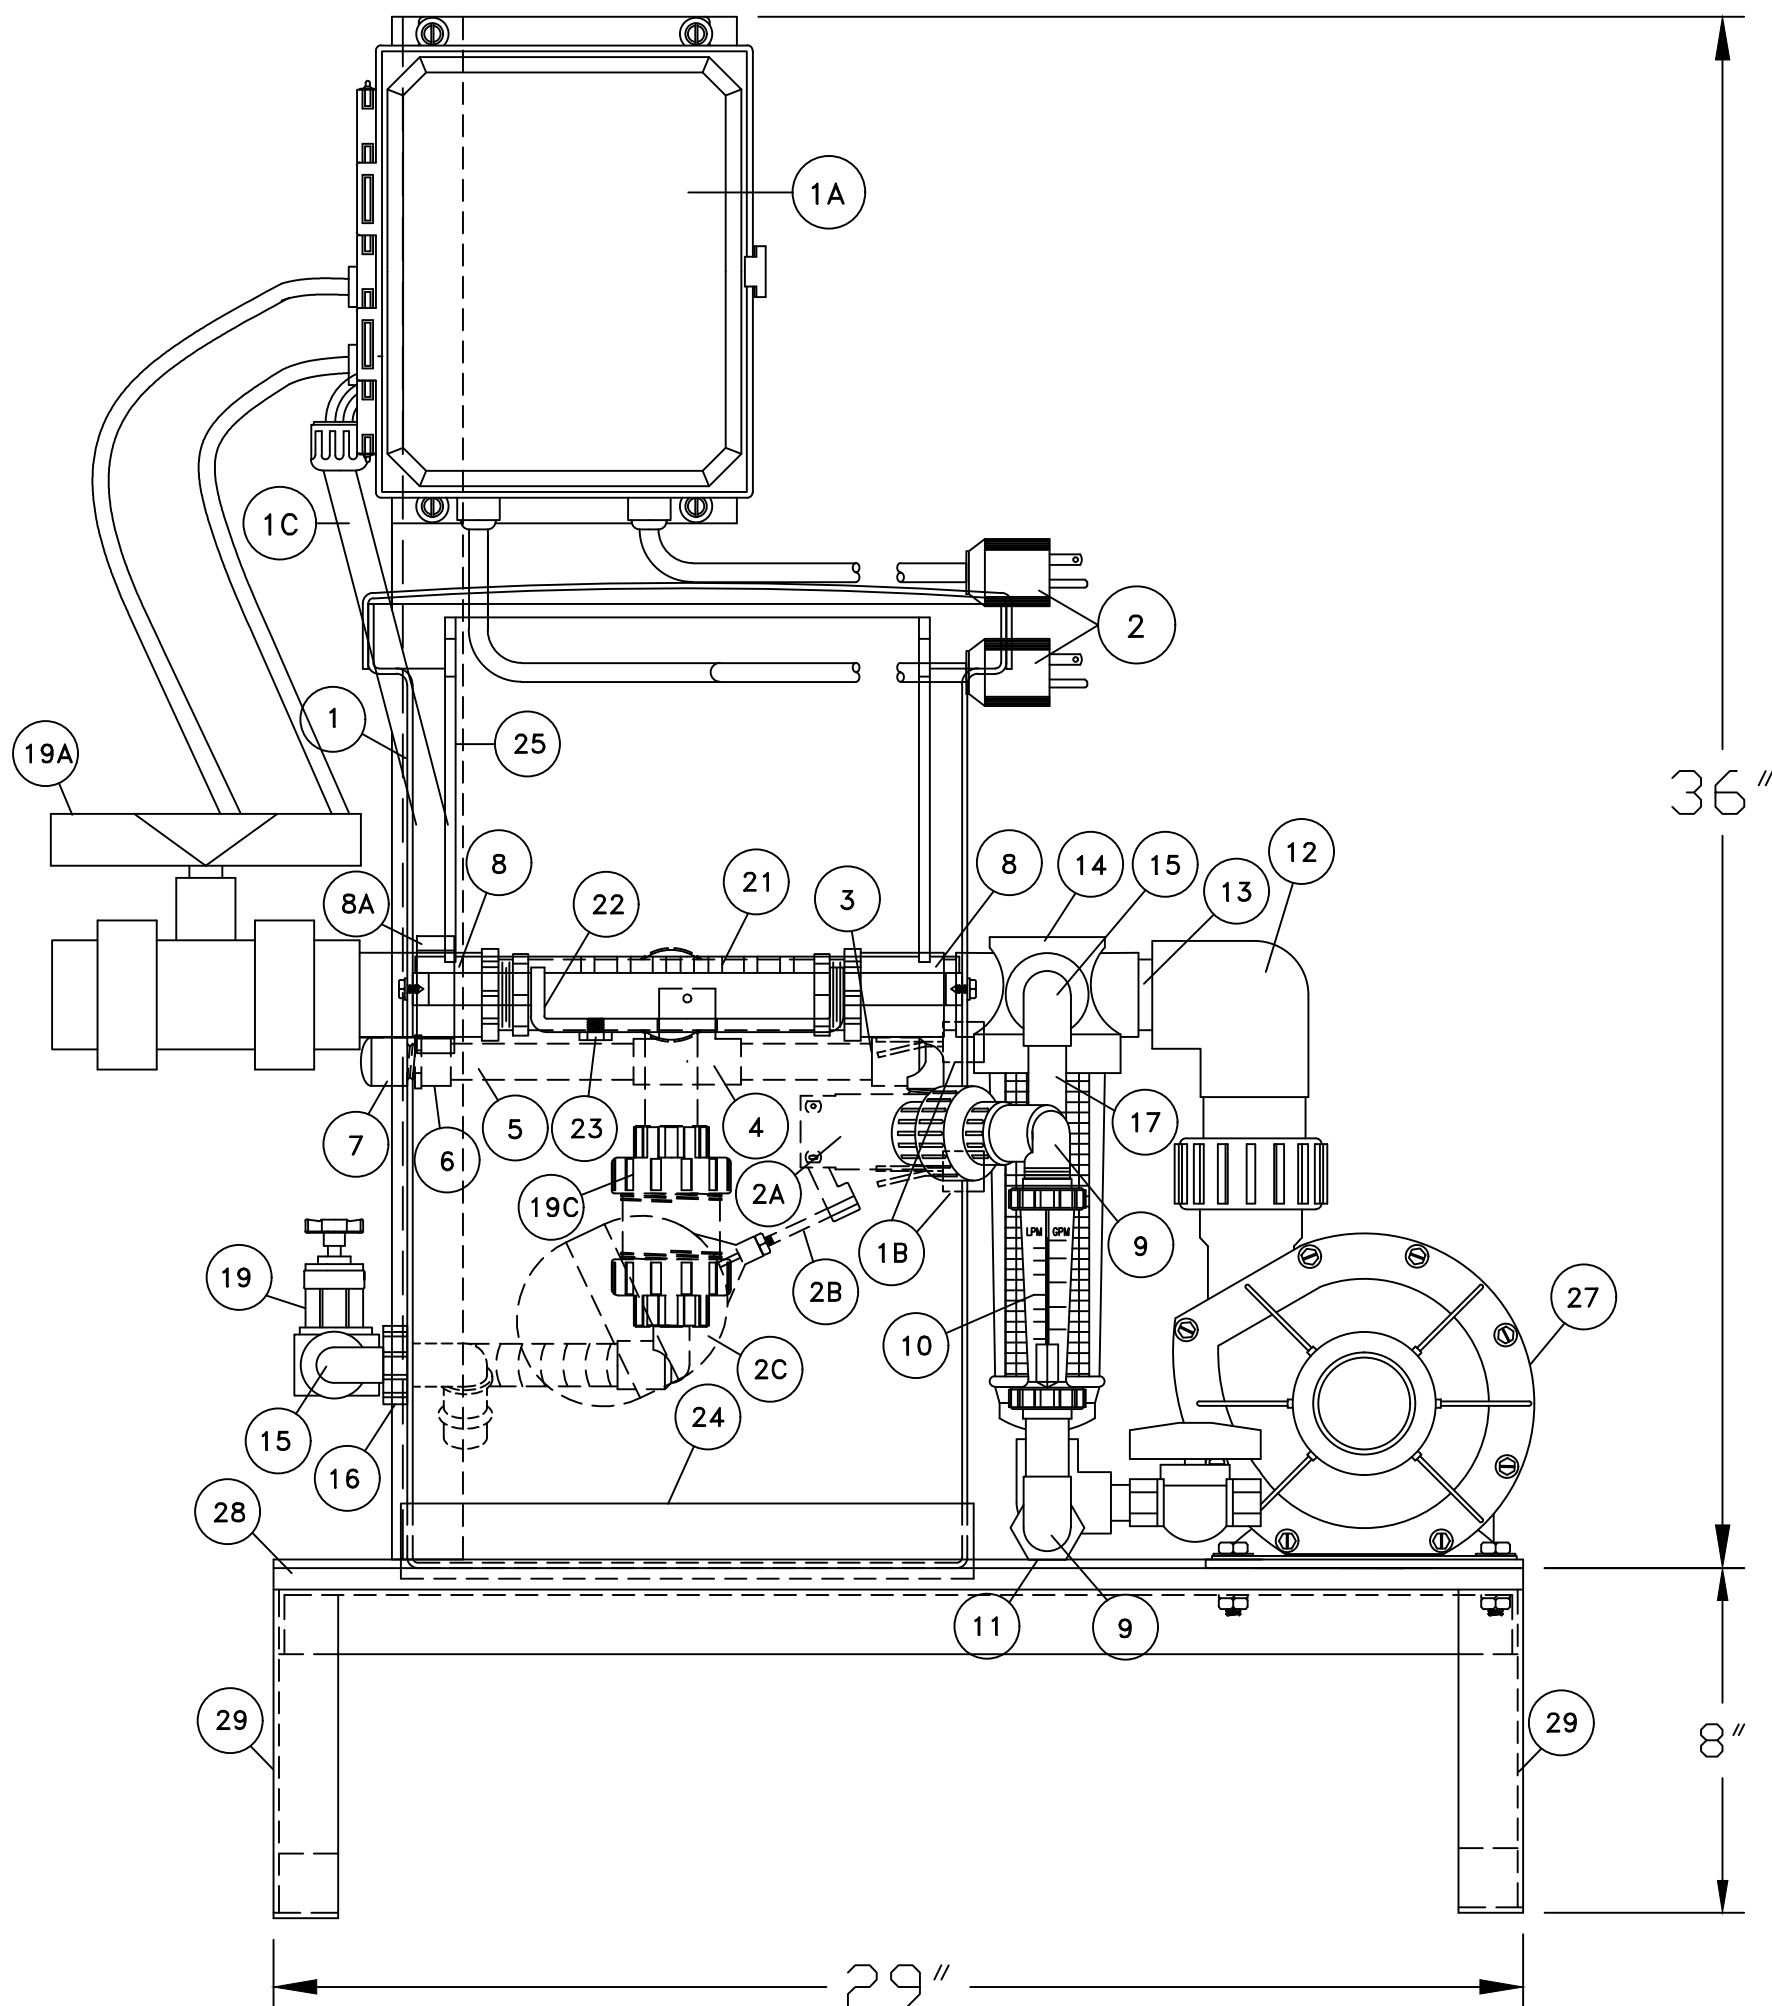

SYSTEM ELEVATION

BILL OF MATERIAL VersaChlor 1(a)

ITEM	QUAN.	DESCRIPTION
1	1	CHEMTAINER 10 GAL. TANK W/ LID MODEL TC1321 13 1/2"x21"H
1A	1	ELECTRICAL CONTROL PANEL W/ 4 BOLTS, WASHERS & NUTS
1B	2	MADISON LEVEL SWITCHES
1C	2	ELECTRICAL CONDUIT WITH (2) CONNECTORS
2	2	±8FT ELECTRICAL CORD WITH 3-PRONG PLUG
2A	1	MILLER PLASTICS FLOAT VALVE, 1/2-0.312-3/4
2B	1	3" 316 SS ROD
2C	1	4"ø X 5" LG. FLOAT BALL
3	1	1/2" STREET ELL, MPT X SOC, SCH. 40 PVC
4	1	1/2" X 1/2" X 3/4" SOC TEE, SCH. 40 PVC
5	A.R.	1/2" SCH. 40 PVC PIPE
6	1	1/2" SCH. 40 PVC MALE ADAPTOR
7	1	1/2" SCH. 40 PVC CAP, FPT
8	2	1 1/2" FPT ADAPTOR, SCH. 40 PVC
8A	1	1 1/2" PIPE CLAMP
9	2	1/2" 90° ELL, FPT X FPT, SCH. 40 PVC
10	1	FLOWMETER, BLUE & WHITE
11	1	1/2" MPT X 3/4" SOC ADAPTOR, SCH. 40 PVC
12	1	1 1/2" STREET 90° ELL SCH. 40 PVC
13	A.R.	3/4" SCH. 40 PVC PIPE
13A	A.R.	1 1/2" SCH. 40 PVC PIPE
14	1	3/4" RUSCO 60 MESH INLET FILTER
14A	1	1 1/2" X 1 1/2" X 3/4" SCH. 40 PVC TEE
14B	1	3/4" CLOSE NIPPLE
14C	2	3/4" X 3/4" THD X THD SCH. 40 PVC UNION
15	2	3/4" STREET ELL, MPT X SOC, SCH. 40 PVC
16	1	3/4" BULKHEAD FITTING, T X T
17	AR	3/4" SCH. 40 PVC PIPE
18	1	3/4" S X S SCH. 40 PVC UNION
19	1	3/4" PVC GATE VALVE, FPT
19A	1	1 1/2" SCH. 40 PVC TRUE UNION BALL VALVE
19B	1	1 1/2" SCH. 40 PVC VITON TRUE UNION BALL VALVE
19C	1	3/4" SCH. 80 PVC TRUE UNION BALL CHECK VALVE
20	1	1 1/2" VENTURI
21	1	3/8" PVC SIEVE PLATE-(33) 1/4"ø HOLES
22	1	SIEVE PLATE DISTRUBUTOR-6" DWV CAP,
23	1	DRILL, TAP & INSTALL 3/8" PLUG ON BOTTOM
24	1	SUPPORT RING, 14"ø PIPE X 1 3/4" TALL, HELD IN PLACE WITH PVC GLUE
25	1	INTERNAL BASKET OF 11" DUCT, CEMENTED TO SIEVE PLATE. HEIGHT 8". (2) THUMB HOLES AT TOP
26	AR	3/4" SPA FLEX PIPE
27	1	HAYWARD 1 HP PAPP100C MOTOR
28	1	1/2" X 20 1/2" X 28 1/2" PVC BASE
29	1	1 1/2" ALUMINUM ANGLE 8" X 21" X 29"

0	04/27/18	ISSUED FOR FABRICATION	RMH	
NO	DATE	REVISION	BY	APPD
TITLE: VERSACHLOR 1(A) PACKAGE				
 WTP		DRAWN: RMH	DATE:27 APR 2018	
		DWG VERSACHLOR 1(A)	REV 0	